


NOTE:

1. LID TO BE COVERED WITH 100mm RIGID S.M. BLUE STYROFOAM INSULATION
2. 2 -COATS OF SPRAY ON WATERPROOFING TO ALL WALLS
3. 50mm SPRAYED ON INSULATION TO MANHOLE BELOW GRADE.
4. STANDARD METER AND READER TO BE SUPPLY AND INSTALLED BY BLUEWATER POWER.
5. DUAL CHECK BACKFLOW PREVENTER TO BE SUPPLY AND INSTALLED BY BLUEWATER POWER.

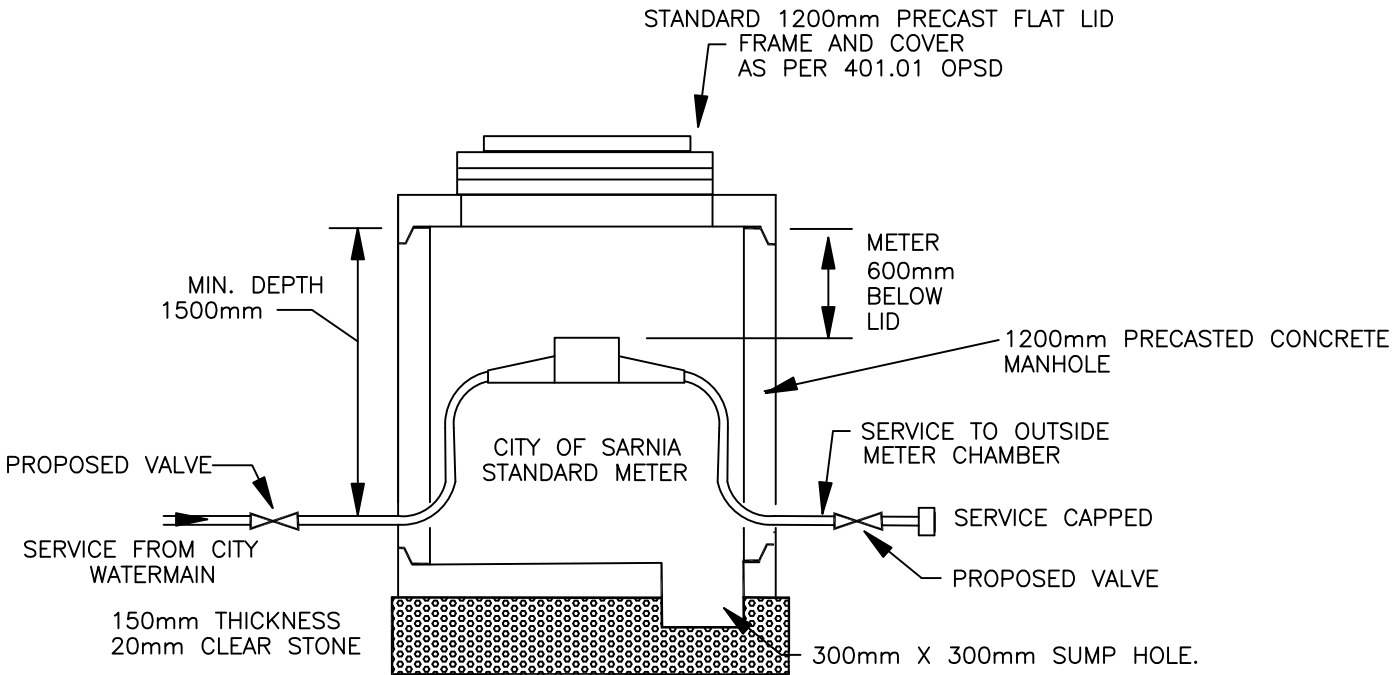

REV.#	DESCRIPTION	DATE	AP.BY
CITY OF SARNIA			
STANDARD METER PIT			
APPROVED BY:			BK.
DRAWN BY: DS	SCALE: N.T.S.	DWG.No.	
CHK' BY:	DATE: JUNE/11	115-SF	