


**NOTES:**

1. ALL PEX TUBING TO BE INSTALLED WITH TRACER WIRE.
2. SADDLES FOR CI,DI & ASBESTOS CEMENT PIPE SHALL BE GALVANIZED STEEL STRAPS AND BOOTS. SADDLES TO BE TREATED WITH A PETROLATUM COATING SYSTEM.
3. SADDLES FOR PVC SHALL BE FULL WIDE STAINLESS STEEL BAND, NUTS, BOLTS AND OUTLET.

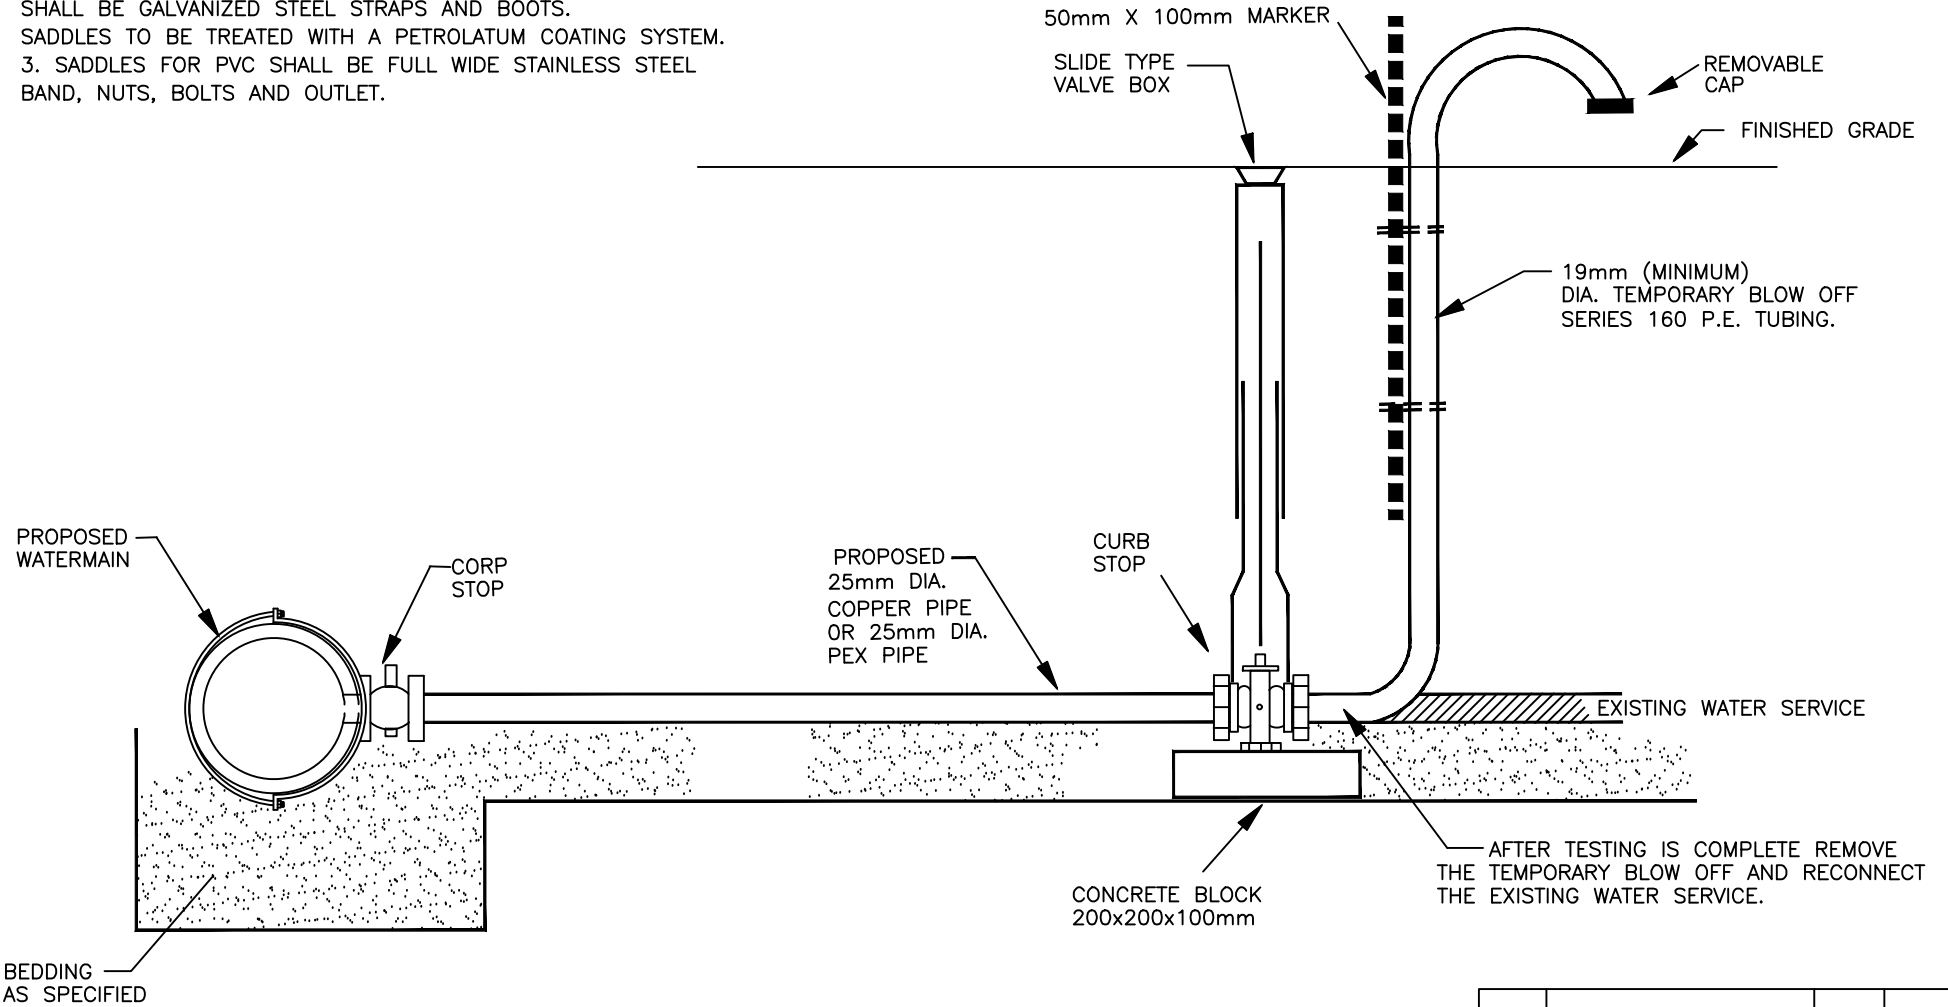

1	REVISION FOR 2018	01/18	BL
REV.#	DESCRIPTION	DATE	AP.BY
<b>CITY OF SARNIA</b>			
<b>TYPICAL TEMPORARY WATER SERVICE BLOW OFF INSTALLATION</b>			
APPROVED BY: RW			BK.
DRAWN BY: DS	SCALE: N.T.S.	DWG.No.	
CHK' BY: RW	DATE: Jan/13	<b>150-G</b>	

NOTE -  
1"Ø PEX / 1"Ø COPPER OR ABOVE