


NOTES:

1. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE NOTED.
2. SUB-DRAINS TO BE 150mm DIAMETER PERFORATED PIPE AS PER STANDARD SPECIFICATIONS.
3. SUB-DRAINS TO EXTEND FROM THE MANHOLE IN EACH DIRECTION OF THE STORM SEWER A DISTANCE OF 6.0m.
4. SUB-DRAINS WILL BE INSTALLED INTO A MANUFACTURER PROVIDED HOLE IN THE MANHOLE OR A CORED HOLE. THESE HOLES MAY BE ON THE SIDE OF THE MANHOLE WITH A TEE CONNECTION.

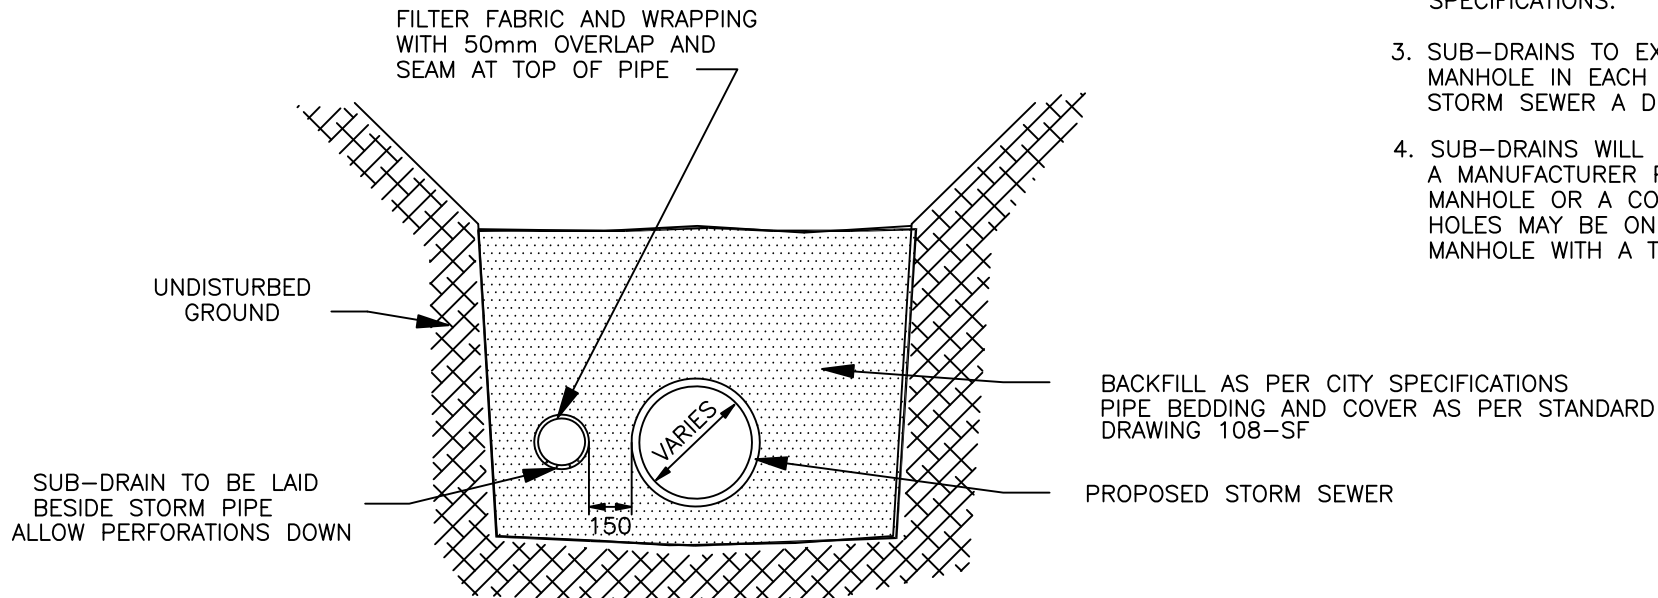

DETAIL "B"

- PROPOSED STORM SEWER

REV.#	DESCRIPTION	DATE	AP.BY
CITY OF SARNIA			
STANDARD METHOD OF INSTALLING 150mm STORM SUB-DRAIN PIPE PARALLEL TO STORM SEWER			
APPROVED BY:		BK.	
DRAWN BY: DS	SCALE: N.T.S.	DWG.No.	
CHK' BY: RW	DATE: 11/09	2071-S1	