

NOTE: TEMPORARY WATER SIZE
 DICTATED BY NUMBER OF PROPERTIES
 SERVED. REFER TO TENDER
 SPECIFICATIONS AND DRAWINGS

ONCE TEMPORARY WATER IS IN
 SERVICE, EXISTING W/M MUST BE
 CUT AND CAPPED, AND TAKEN OUT
 OF SERVICE

NOTE: WATERMAIN AND
 APPURTENANCE SIZES AS
 PER PLAN


HYMAX COUPLING
 C/W STONE BEDDING

EXISTING
 WATERMAIN

PROPOSED
 WATERMAIN

NEW
 PUSH-ON
 GATE VALVE

NEW M.J. TEE
 (OR 90° ELBOW)

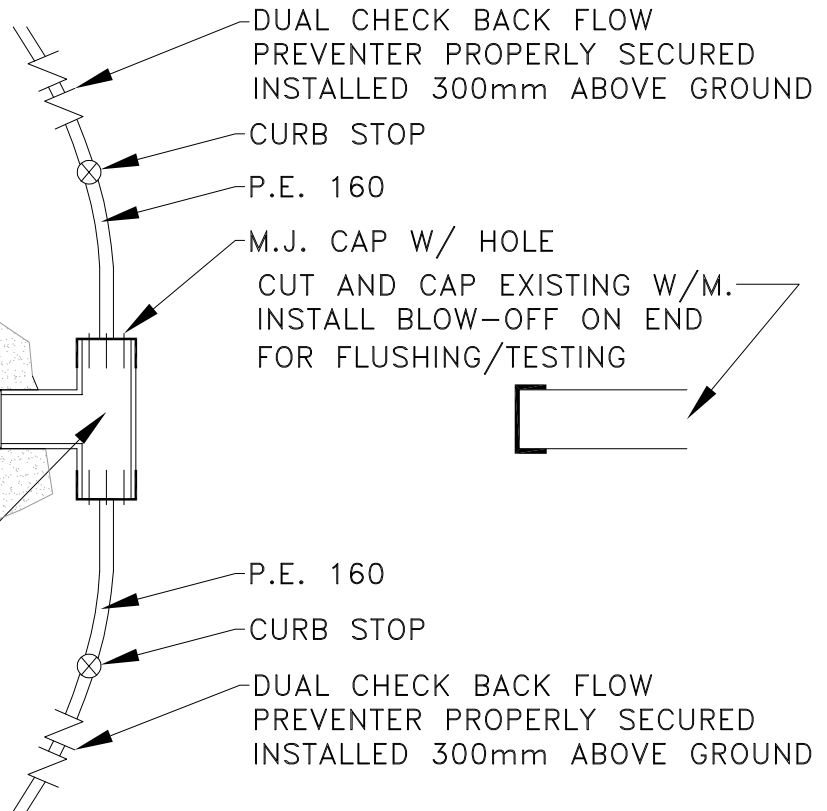

DUAL CHECK BACK FLOW
 PREVENTER PROPERLY SECURED
 INSTALLED 300mm ABOVE GROUND

CURB STOP

P.E. 160

M.J. CAP W/ HOLE
 CUT AND CAP EXISTING W/M.
 INSTALL BLOW-OFF ON END
 FOR FLUSHING/TESTING

P.E. 160

CURB STOP

DUAL CHECK BACK FLOW
 PREVENTER PROPERLY SECURED
 INSTALLED 300mm ABOVE GROUND

CITY OF SARNIA

TYP. TEMPORARY WATER SUPPLY DETAIL

APPROVED BY:

BK.

DRAWN BY: G.H.

SCALE: N.T.S.

DWG.No.

CHK' BY:

DATE: JAN 2010

2600