


NOTE  
 ALL JOINTS AND FITTINGS TO BE RESTRAINED AS PER CITY OF SARNIA STANDARDS  
 ALL FITTINGS TO RECEIVE FULL PETROLATUM COATING TREATMENT.

**PLAN**  
 N.T.S

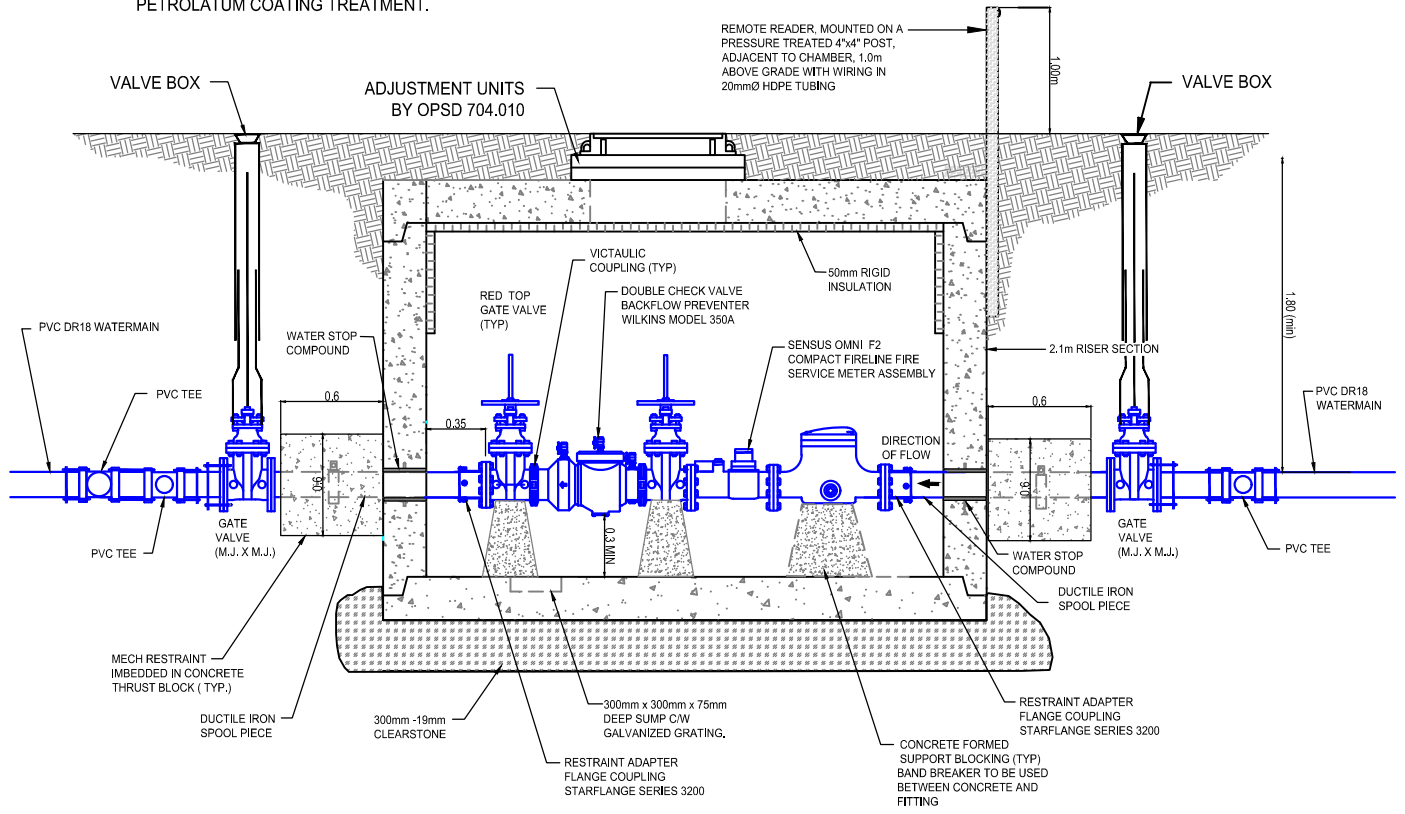

**SECTION**  
 N.T.S

ITEM	DIMENSION
SENSUS OMNI F2 FIRE SERVICE METER	1143mm FLANGE TO FLANGE
DOUBLE CHECK VALVE ASSEMBLY WILKINS MODEL 350A	1200mm FLANGE TO FLANGE

REFER TO O.P.S.D. 1008.010 FOR CHAMBER CONSTRUCTION

<b>CITY OF SARNIA</b> <b>PRECAST CONCRETE METER &amp; BACKFLOW PREVENTER CHAMBER</b>	APPROVED BY:		
	DRAWN BY:	SCALE: N.T.S.	DWG.No.
	CHK' BY:	DATE: JAN 2023	<b>3900</b>