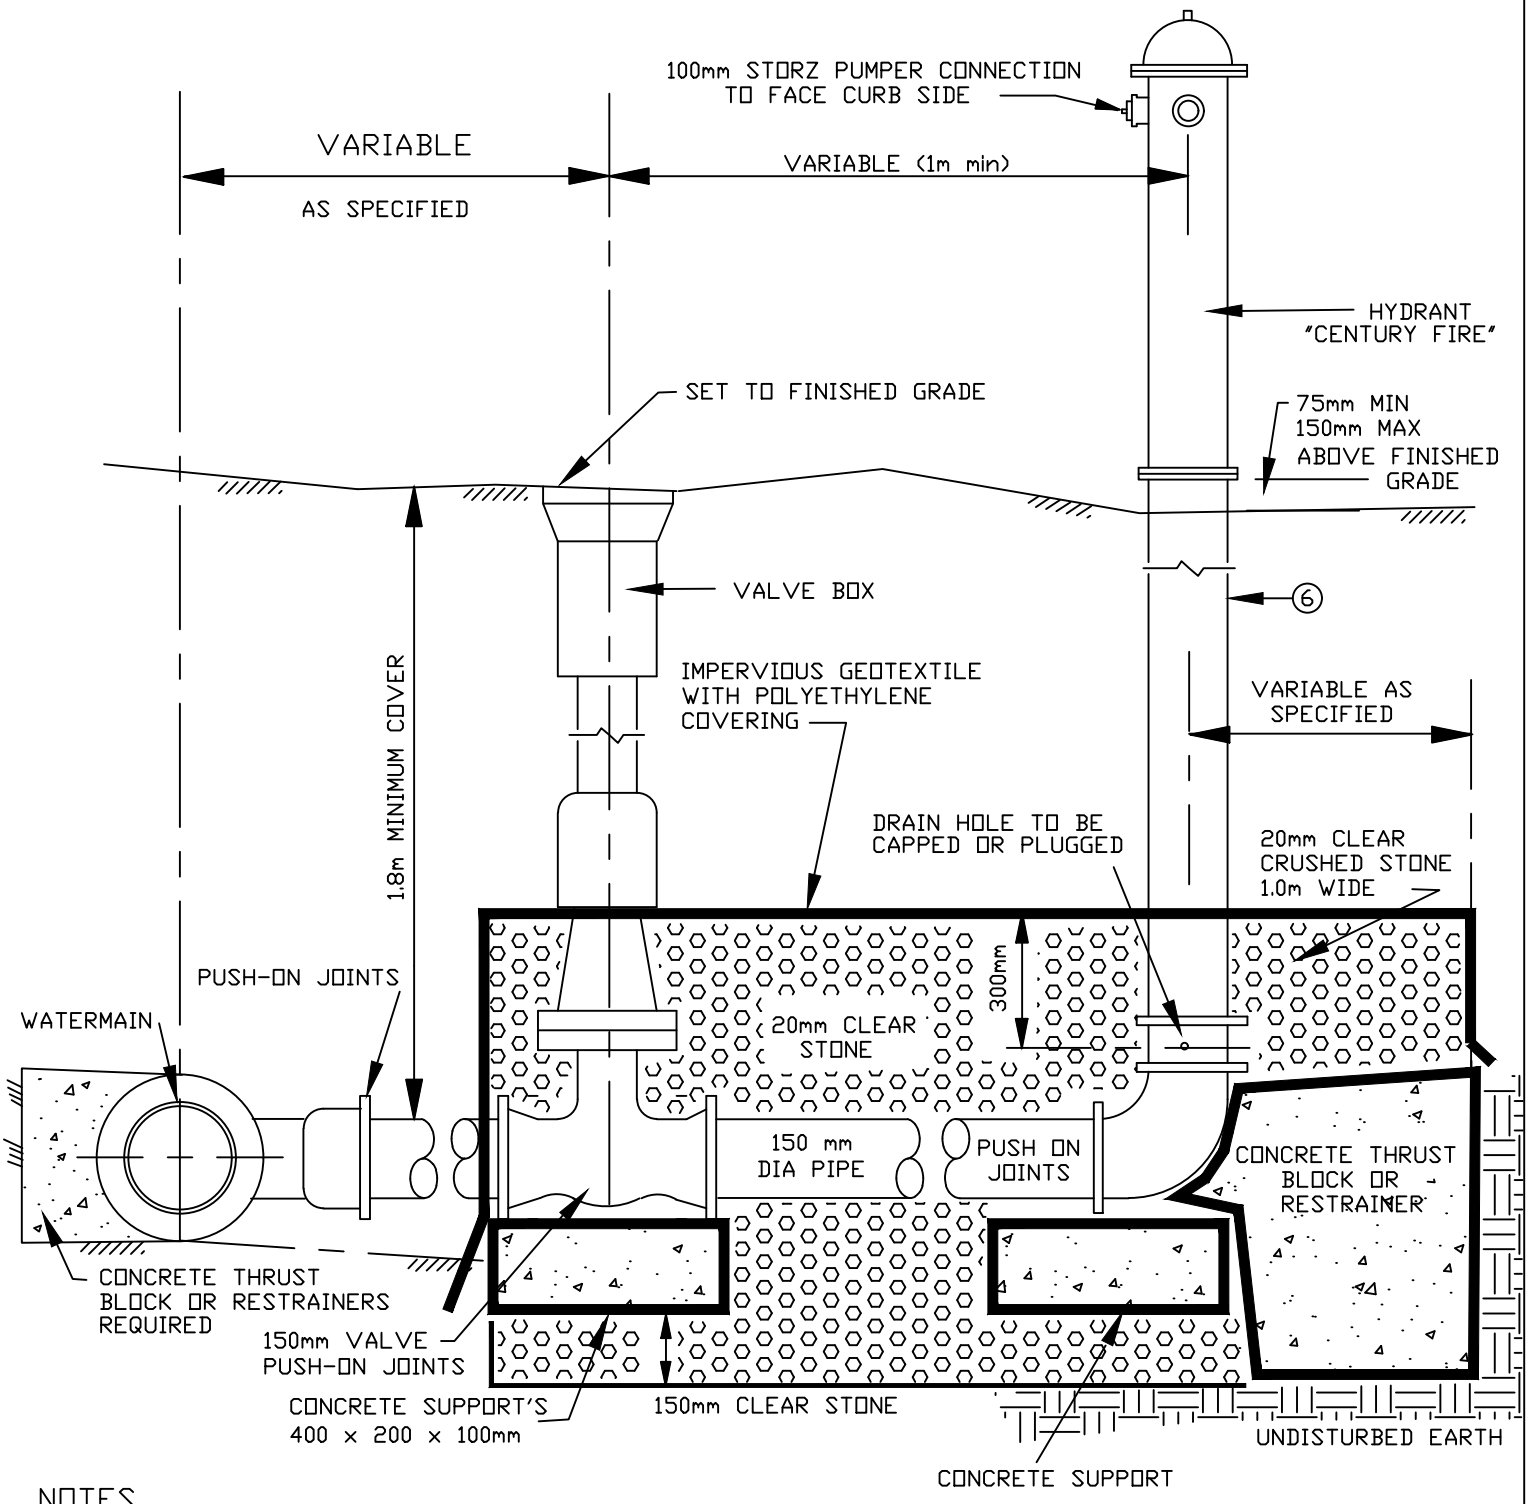

NOTES

1. ALL CONCRETE THRUST BLOCKS TO BE POURED AGAINST UNDISTURBED GROUND AS PER OPSD 1103.02
2. POLYETHYLENE BOND BREAKER TO BE USED BETWEEN CONCRETE AND FITTINGS
3. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SHOWN
4. HYDRANT DRAIN HOLES ARE TO BE CAPPED OR PLUGGED
5. HYDRANTS SHALL BE A MIN. OF 1.98m LONG FROM THE SPRING LINE OF THE HYDRANT LEAD TO THE BREAK AWAY FLANGE UNLESS OTHERWISE REQUIRED.
6. PETROLATUM COATED AS PER ITEM #15 IN WATER MAIN MATERIAL AND ITEM #1 IN GENERAL PROVISIONS
7. UPPER BARREL TO BE PAINTED AS PER ITEM #9 IN WATER MAIN METHODS.
8. FIRE HYDRANTS FLOW TESTING AS PER WATERMAIN TESTING PROCEDURES - ITEM #9

REV 9	REVISED FOR 2018 SPEC.	01/2018	BL
REV 8	REVISED FOR 2016 SPEC.	01/2016	DD
REV 7	FIXED DIM , ADDED NOTES 6-9	05/2014	E.C.

CITY OF SARNIA

HYDRANT INSTALLATION

APPROVED BY: S.W.		FIELD BOOK#
DRAWN BY: J.R.	SCALE: N.T.S.	DWG.# 95-SF
CHK'D BY: T.W.	DATE: JAN-1993	