

DETACHED RESIDENTIAL ACCESSORY BUILDINGS



SARNIA
ONTARIO

Note:

Detached accessory buildings, such as garages and storage sheds, vary in size and area. It is beyond the scope of this booklet to deal with every possible situation. The requirements and construction guidelines that follow are provided to assist you in designing and constructing a detached garage or storage shed which will comply with the regulations. If the nature of your project is different than that contained in this booklet and you are not familiar with the regulations which may be applicable, it is recommended that you contact someone who is knowledgeable in this area.

The Sarnia Building By-law is primarily an administrative document that adopts the Ontario Building Code and related standards to provide construction requirements. Throughout this booklet the information provided is based on the minimum standards set out in the Ontario Building Code and City Zoning By-law. Every effort has been made to ensure the accuracy of information contained in this booklet. However, in the event of a discrepancy between this booklet and the governing Act, Regulation or By-law, the Act, Regulation or By-law will take precedence.

We strongly encourage applicants to discuss their specific projects with Building Services staff within the City prior to commencement.

Permit Requirements

In many instances a Building Permit is required for accessory buildings.

Is a building permit required to build a detached garage, storage shed or carport?

Any accessory building over 10m² (107 sq. feet) in size will require a building permit.

A **shed** up to 15m² (161 sq. feet) does not require a permit, provided that the shed:

- (a) is not more than one storey in building height;
- (b) is not attached to a building or any other structure;
- (c) is used only for storage purposes ancillary to a principal building on the lot; and
- (d) does not have plumbing.

Permit Application Information

Depending on the project you may be required to submit a Building Permit Application, Site Plan and Construction Plan.

Building Permit Application


You must complete a Building Permit Application in full.

Site Plan

You will need to attach a site plan consisting of the property measurements, dwelling and any other building locations and measurements. Indicate front, side, and rear setbacks from the lot lines. Location and size of the proposed garage or shed must also be included. See example to the right.

Frequently Asked Question:
Can I assume that the City sidewalk, edge of pavement, or neighbour's fence is the property line?

No. To accurately determine the location of your property line, please speak to a Land Surveyor.

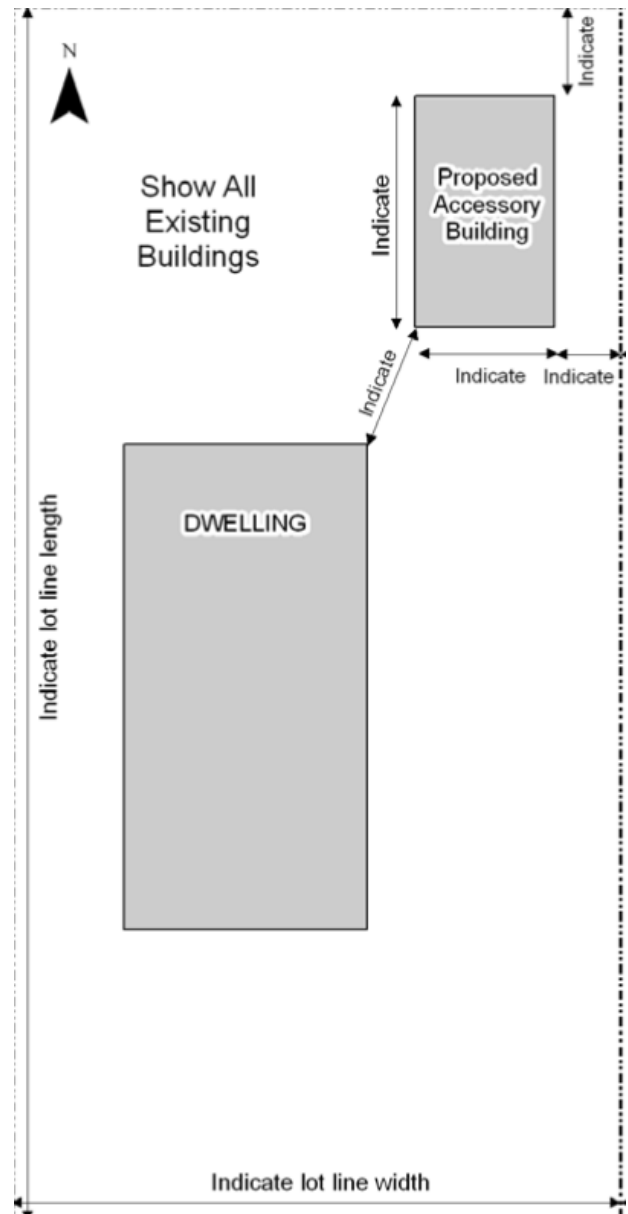

Construction Plans

The requirements for construction plans vary based on building type, features and size.

Garage/Shed not more than 55m²

Smaller buildings do not normally require submission of detailed construction plans. Sketches and a site plan are acceptable for these types of structures, however in some instances, plans and designs may be required from a professional engineer. Review this document for such situations or call Building Services directly.

Garage/Shed more than 55m²

Larger buildings require submission of a floor plan, section and elevations. These plans must be clear and to scale. There must also be sufficient detail to allow building staff to determine compliance to the Ontario Building Code. If you are having someone else provide the plans they must be registered with the Ministry of Housing (MMAH) as a registered designer.

What is required to be shown on the floor plan:

- Size of garage/shed with dimensions
- Location and sizes of windows, doors, etc.
- Size of beams/lintels in wall openings, if required
- Direction of roof trusses

What details are required on the section drawing:

- Type and thickness of materials in the roof, walls and floor construction assembly
- Dimension of height of wall, pitch of roof and size of overhang

What information should be indicated on the elevation drawing:

- Type of finish siding material
- Window and door location
- Indicate roof slope and overhang (OH)
- Total building height
- Foundation line
- Grade line

Zoning

PLEASE NOTE: The following setbacks are only generalized guidelines. Please speak with a City Planner to confirm setback requirements for your specific property.


Property Line Setbacks

How far away from the property line should my building be?

Any accessory building needs a minimum clearance of one metre from a dwelling located on the same lot, measured eave to eave.

In most cases, to build in a rear yard, a detached accessory building needs to have a minimum building setback of 0.6m from the rear and side property lines (Figure 1).

Figure 1:

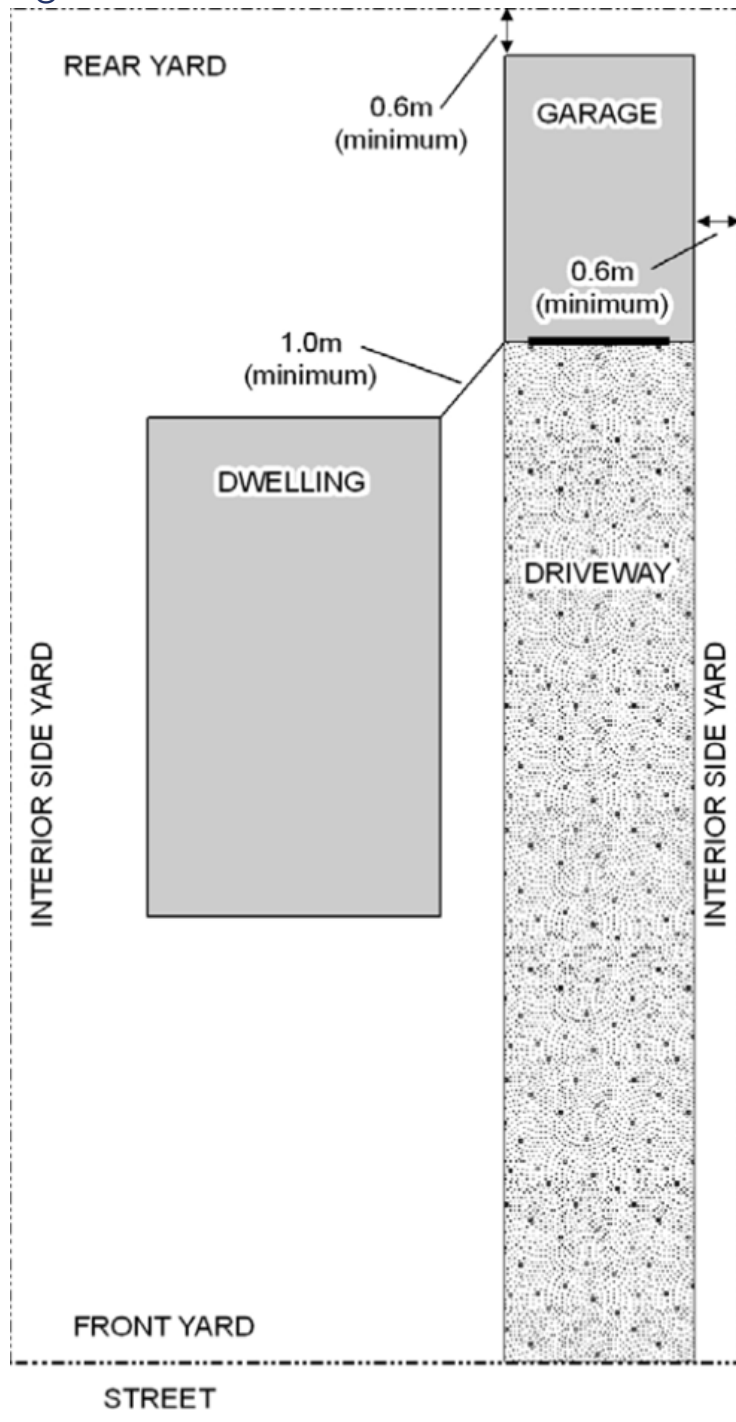


Setbacks for Corner Lots

The setbacks for detached accessory buildings on corner lots vary — depending on the location of the corner lot where they are built, and the configuration of the abutting lots.

For corner lots — it is recommended that you contact a City Planner to discuss your building proposal.


As shown in Figure 2, where the side lot line of a corner lot (shown as “A”) is the continuation of the front lot line of an adjoining lot (shown as “B”) - a detached accessory building **on the corner** lot shall be set back the same depth as is required for the front yard of the adjoining lot is (shown as “C”). The building setback to the side lot line of the adjoining lot shall be at least 1.2m (shown as “D”).

Figure 2:

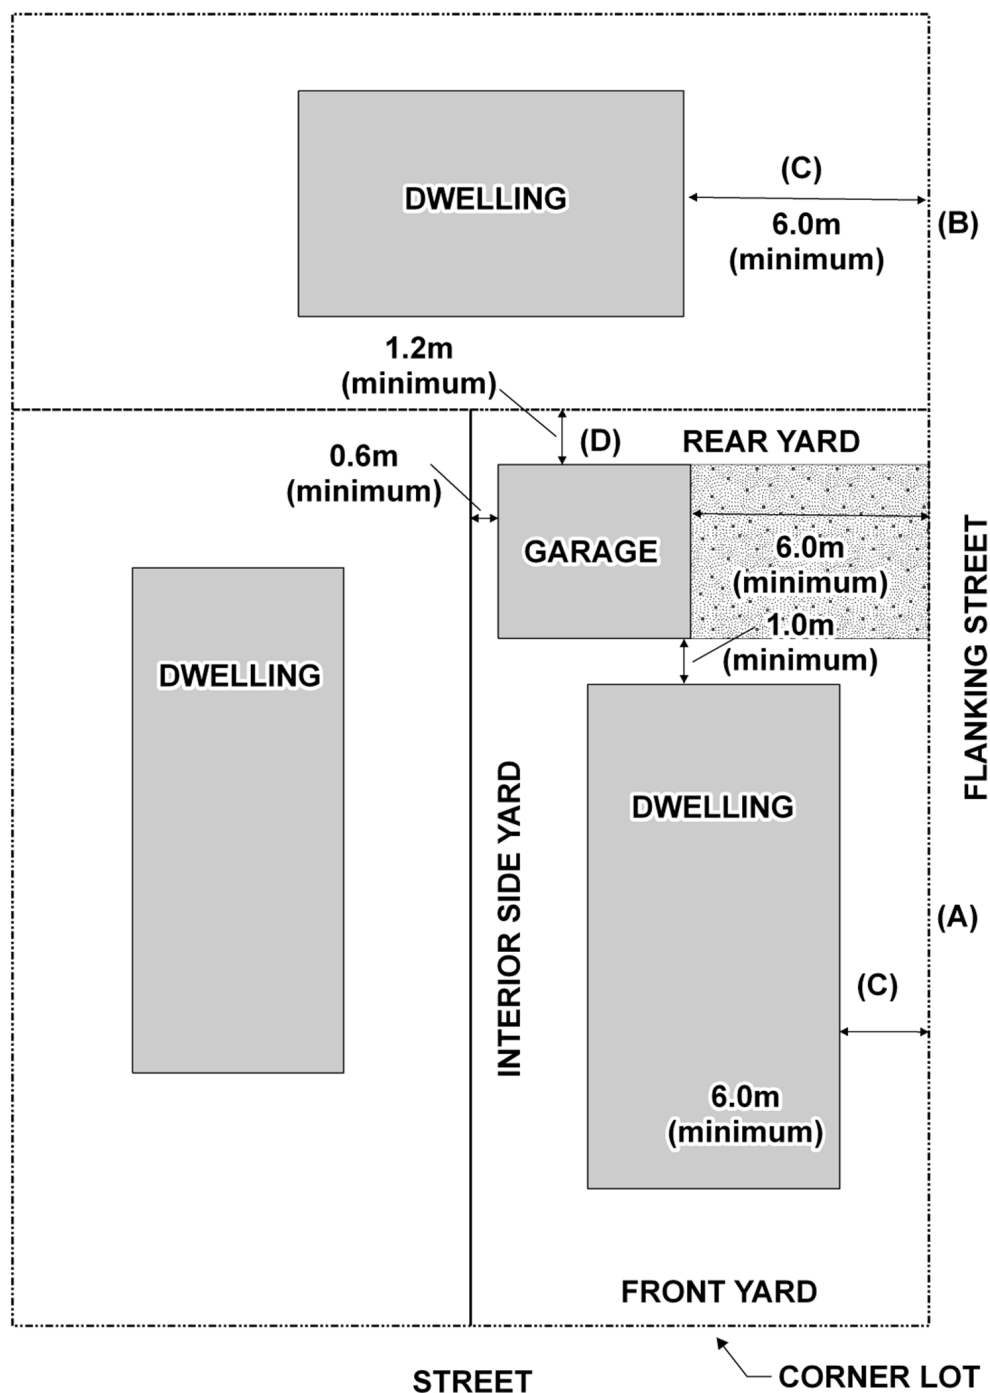

Do these setbacks include the overhang?

The setback does not include an eave projection which needs to have a minimum setback of 0.3m from the property line. (See illustration below)

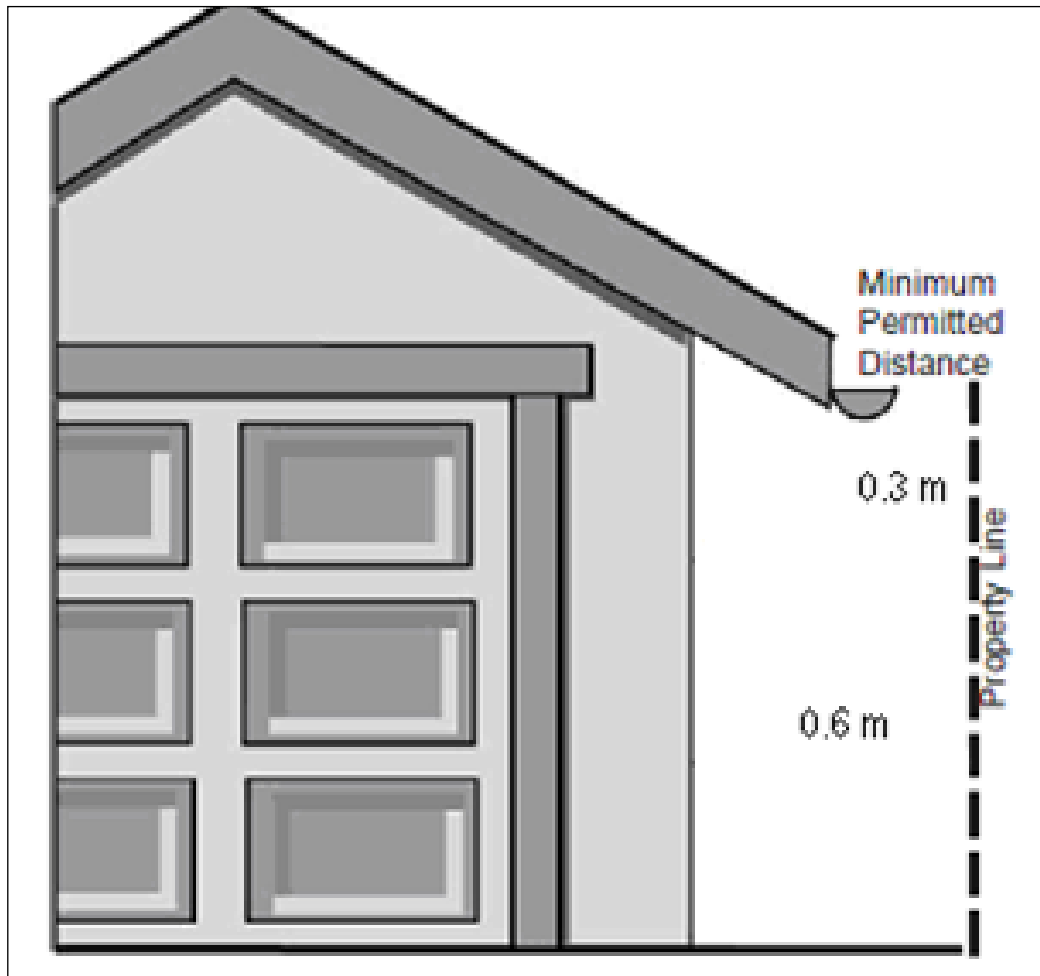

What is the maximum height allowable?

The maximum height for an accessory building with a peaked roof is one storey which is not more than 5m from average grade. However, if the accessory building has a flat roof, the maximum building height can be one storey and not more than 3.5m from average grade.

How large of a garage can I build?

In any Residential Zone, the maximum combined lot coverage for all accessory buildings shall be 10 per cent of the lot.

If I cannot meet these requirements, what are my alternatives?

City Council has appointed a Committee of Adjustment to consider applications for relief from the By-law requirements. To apply for a minor variance, please contact a Planner at City Hall.

Foundation Requirements

Based on the type and size of the building there are different recommendations and requirements for foundations.

What type of foundation is required for a one-storey wood frame detached garage?

For a detached garage having a building area of less than 55m² it is recommended that a concrete slab with a thickness of not less than 100mm be used as shown in Figure 4a.

For a building area of 55 to 65m² inclusive, it is recommended that a thickened edge concrete slab be used as shown in Figure 4b or 4c.

For foundations other than those shown in Figures 4a and 4b, or if the building area is greater than 65m², or if brick or masonry veneer is to be installed, the foundation must be designed as per Figure 4c, or by a professional engineer registered in the Province of Ontario.



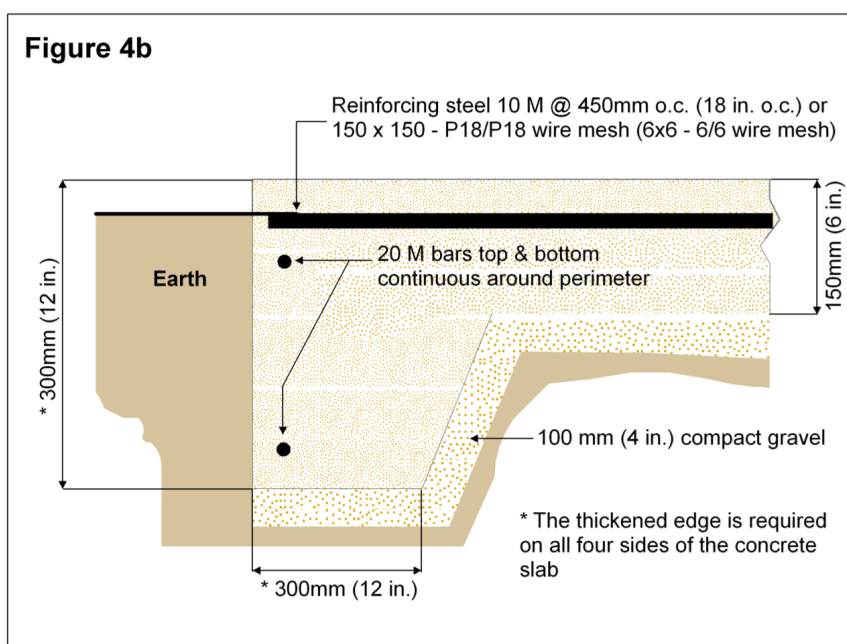


Figure 4c

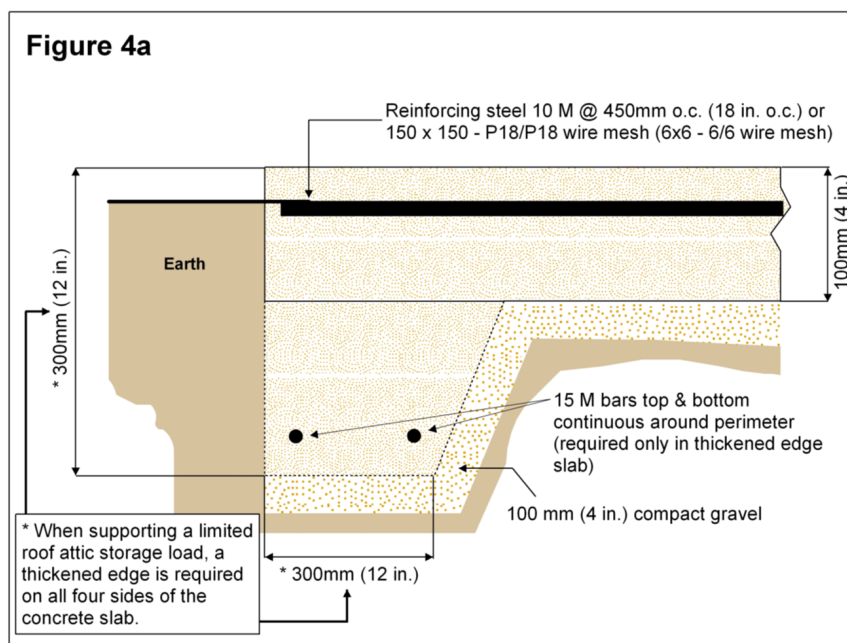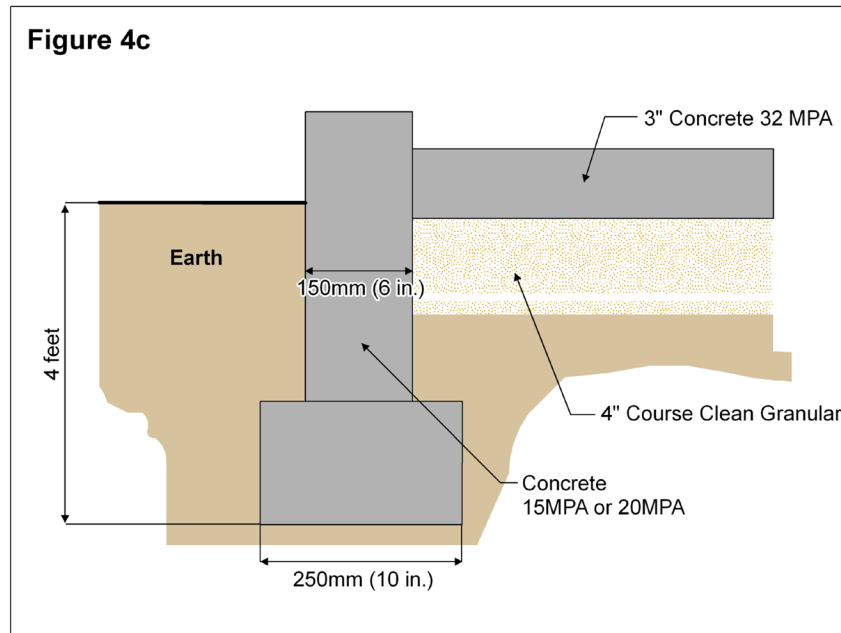

What if I add on to my existing garage?

For a garage, shed or carport addition to an existing structure, the entire foundation, both the existing and the addition, must be made to comply with the foundation requirements shown in Figures 4a, 4b and/or 4c or alternatively the foundation must be designed by a professional engineer.

Can I vary from the foundation slab details shown in this pamphlet?

The details and standards in the pamphlet are considered non-engineered details and are based on past "good construction practice". Variations from these design standards are ONLY permitted where the design is by a professional engineer.

Some variations that will require an engineer are:

1. Wood mudsill foundation and anchorage details to prevent uplift due to wind.
2. Foundation slab that includes a curb of more than 150mm or retaining wall to hold back the earth where the lot is not level.
3. Foundation slab that is greater than 70m²
4. Foundation slab that supports brick or masonry construction.

What type of concrete do I require for my foundation slab?

Concrete used for all detached garage or shed foundation slabs must have a minimum compressive strength of 32 MPa after 28 days and must have air entrainment of 5 to 8 per cent.

Framing

The framing details described in this pamphlet are based on a 1-storey wood framed structure that do not include any additional superimposed loads and further design consideration may be required to address these additional superimposed loads. Framing methods must be in accordance with good engineering practice. A detailed

discussion of this aspect of construction is beyond the scope of this publication. However, some common framing details are indicated on the following pages. Refer to Figures 5, 6 & 7, and Tables 1 & 2. For more detailed information refer to the book **Canadian Wood Frame House Construction** available to purchase from Canada Mortgage and Housing Corporation (CMHC). This publication is an excellent guide to good framing methods and construction techniques. It also includes information for wall and roof coverings, etc.

Where the structure will not be a standard wood frame structure, such as post and beam, concrete block, brick (including brick veneer) or metal framing or where the framing members exceed that prescribed in this pamphlet, the design must be by a professional engineer and drawings must be submitted under the seal and signature of a professional engineer.

Figure 5 — Wall Framing and Lintel Detail

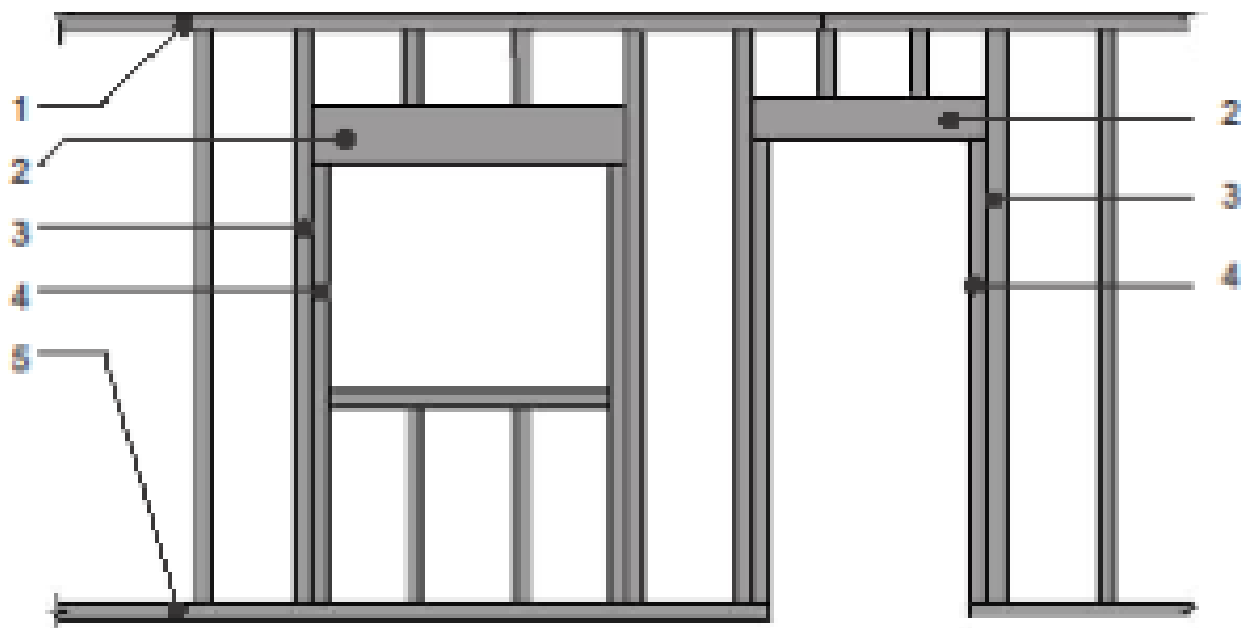


Figure 5 Notes:

- 1. Double Top Plate:** Joints must be staggered at least one stud spacing. Joints are to be lapped or suitably tied at corners or intersecting walls.
- 2. Lintel:** Refer to Table 1 to determine the size of lintel required for the opening width you select.
- 3. King Stud:** Refer to Table 2 to determine the maximum spacing and maximum unsupported height of studs.
- 4. Jack Stud:** The Building Code requires these studs to be a single full length piece of lumber extending from the underside of the lintel to the bottom plate. Two studs are required on both sides of opening when opening is greater than 3m
- 5. Single Bottom Plate:** To prevent uplift, this bottom plate should be firmly anchored down at each side of door openings, at each end of each wall, and at intervals not exceeding 2.4m. Bottom plate is to be pressure treated and or separated from concrete by polymembrane to resist decay.

Figure 6 — Exterior Corner Detail

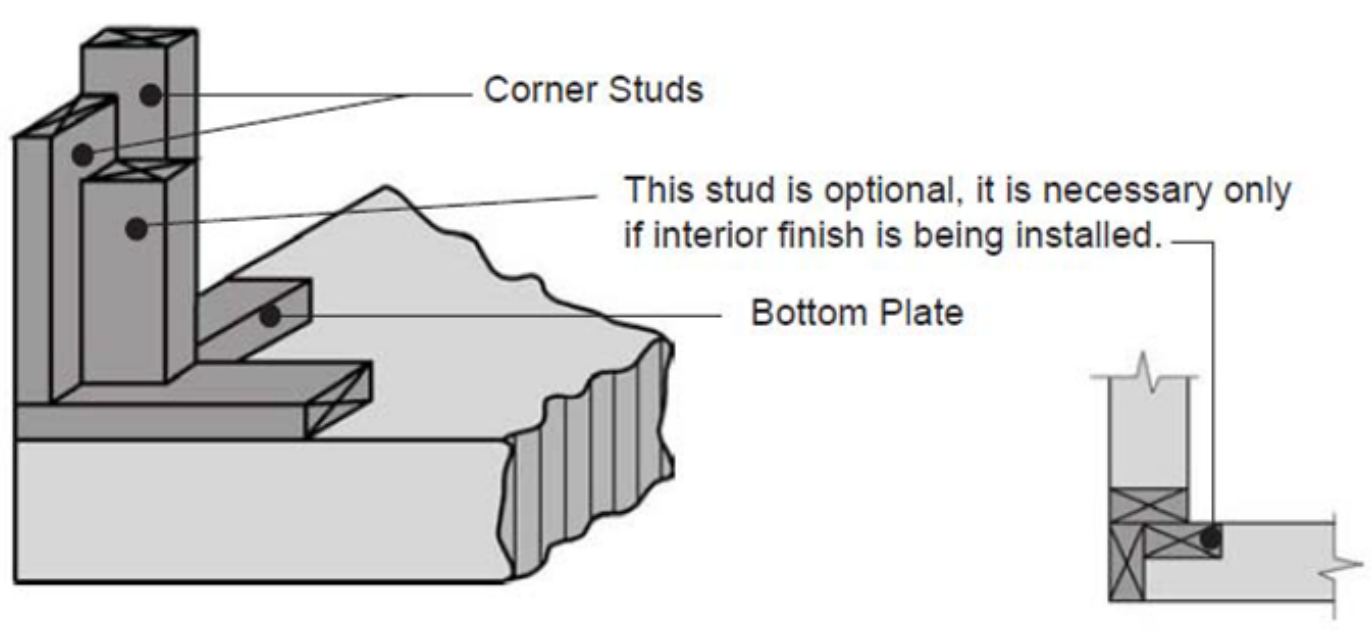


Figure 7 — Exterior Wall Framing at Gable End Detail

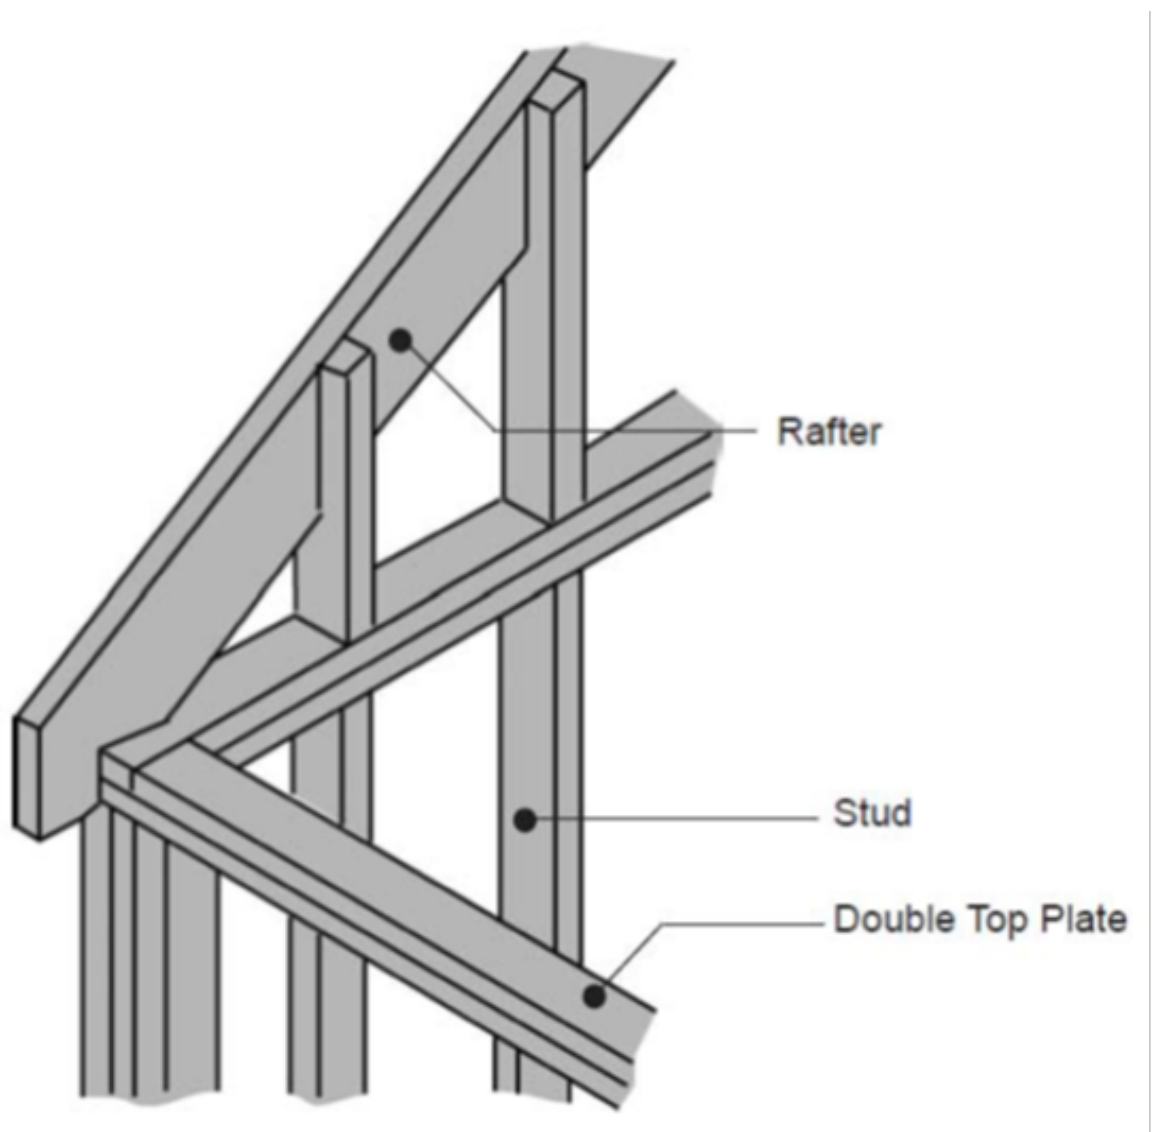


Table 1: Wood Lintel Spans for Windows and Man Doors

Size of Lintels	Maximum Allowable Spans
2 — 38 x 89 mm (2—2 x 4)	1.11 (3' 8")
2—38 x 140 mm (2- 2 x 6)	1.66 (5' 5")
2—38 x 184 mm (2- 2 x 8)	2.02 (6' 7")

Table 1 Notes:

1. This table is for use with Spruce-Pine-Fir lumber grades 1 & 2.
2. Built-up lintels must be constructed of full-length members. No splicing of members is permitted between supports.

Table 2: Size and Spacing of Studs

Type of Wall	Supported Loads (including dead loads)	Minimum Stud Size	Maximum Stud Spacing	Maximum Un-Supported Height
Exterior	Roof with or without attic storage	38 x 140 mm (2" x 6") 38 x 89 mm (2" x 4")	400 mm (16") 600 mm (24")	3.6 m (11' 9 3/4") 3 m (9' 10")

Table 2 Notes:

This table is for use with all Spruce, Pine, Fir Lumber Grade 1 and 2 and minimum grades of standard, stud and No. 2. Solid Bridging to be provided at 1200mm O.C between studs.

Overhead Door Lintels

The size of lintel required depends entirely upon the load which it must support which, in this case, is determined by the style of roof. See Tables 3 & 4.

How are the tables used in determining the required overhead door lintel size?
If the roof style selected is Gable #1 as shown in Figure 8, then Table 3 is used to determine the lintel size. This table is used where the door opening DOES NOT SUPPORT the roof, i.e. where the roof framing elements such as trusses or rafters run parallel to the door opening.

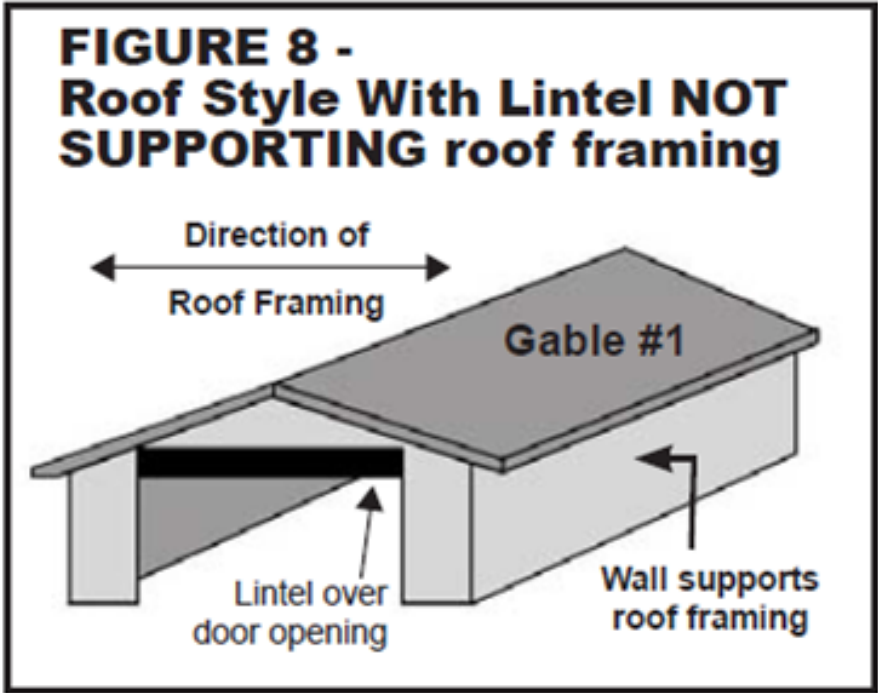


Table 3: Wood Lintels — NOT SUPPORTING Roof Loads

Maximum Door Opening Width	Lintels—Gable Roof Only (Door in Gable End)
4.61 (15' 1")	2—38 x 184 mm (2—2 x 8)
5.76 (18' 10")	2—38 x 235 mm (2—2 x 10)
6.67 (21' 10")	2—38 x 286 mm (3—2 x 12)

- Table 3 Notes:*
- 1. This table is for use with Spruce-Pine-Fir lumber grades 1 & 2.
 - 2. Built-up lintels must be constructed of full-length members. No splicing of members is permitted between supports.

Roof Styles with Lintel Supporting Roof Framing

If the roof type selected is as shown in Figure 9, i.e. Gable #2, Hip, Mono, or Flat, then Table 4 is used to determine the lintel size. This table is used where the lintel over the door opening SUPPORTS the roof, i.e. where the roof framing elements such as trusses or rafters run perpendicular to the door opening.

To select a size of wood lintel simply match the door opening size with the appropriate supported length in Table 4 to find the minimum lintel size.

FIGURE 9 - Roof Styles With Lintel SUPPORTING Roof framing.

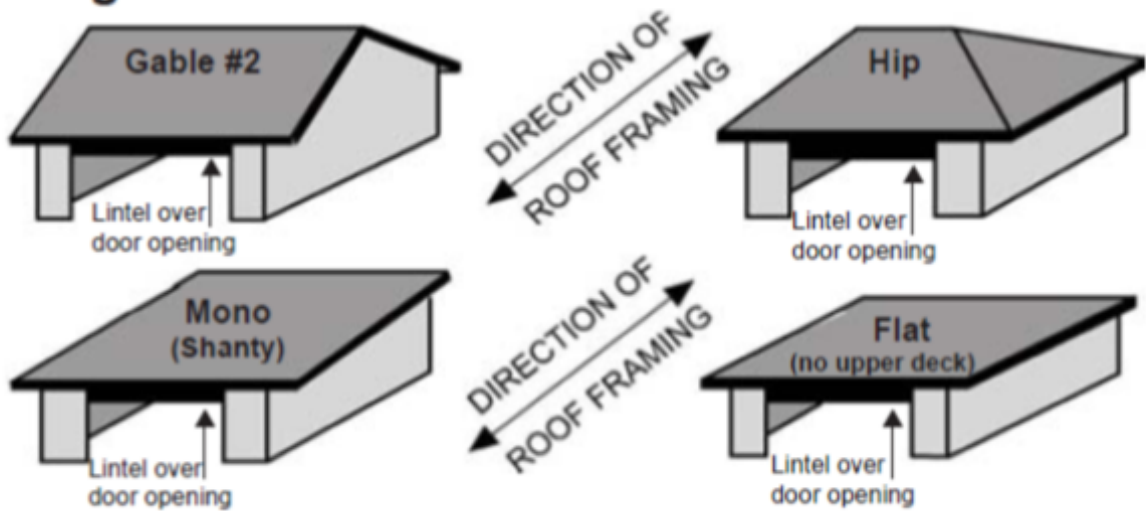


Table 4: Wood Lintels — SUPPORTING Roof Loads

	Supported Length			
Width of Opening (Lintel Span)	2.44 m (8ft) X 1.25	3.66 m (12ft) X 1.10	4.27 m (14ft) X 1.05	4.88 m (16ft) —
2.44 m (8ft)	3 — 38 x 184mm (3 — 2 x 8)	3 — 38 x 184mm (3 — 2 x 8)	3 — 38 x 184mm (3 — 2 x 8)	3 — 38 x 184mm (3 — 2 x 8)
2.74 m (9ft)	3 — 38 x 184mm (3 — 2 x 8)	3 — 38 x 235mm (3 — 2 x 10)	3 — 38 x 235mm (3 — 2 x 10)	3 — 38 x 235mm (3 — 2 x 10)
3.05 m (10ft)	3 — 38 x 235mm (3 — 2 x 10)	3 — 38 x 235mm (3 — 2 x 10)	3 — 38 x 235mm (3 — 2 x 10)	3 — 38 x 286mm (3 — 2 x 12)
3.66 m (12ft)	3 — 38 x 235mm (3 — 2 x 10)	3 — 38 x 286mm (3 — 2 x 12)	3 — 38 x 286mm (3 — 2 x 12)	4 — 38 x 286mm (4 — 2 x 12)
4.27 m (14ft)	3 — 38 x 286mm (3 — 2 x 12)	4 — 38 x 286mm (4 — 2 x 12)	130 x 304 Glue Laminated Timber	130 x 304 Glue Laminated Timber
4.88 m (16ft)	4 — 38 x 286mm (4 — 2 x 12)	130 x 304 Glue Laminated Timber	130 x 304 Glue Laminated Timber	80 x 380 Glue Laminated Timber

5.48 m (18ft)	130 x 304 Glue Laminated Timber	130 x 342 Glue Laminated Timber	130 x 380 Glue Laminated Timber	130 x 380 Glue Laminated Timber
6.09 m (20ft)	130 x 342 Glue Laminated Timber	80 x 456 Glue Laminated Timber	80 x 532 Glue Laminated Timber	80 x 532 Glue Laminated Timber

Table 4 Notes:

1. The lintels in this table are Spruce-Pine-Fir lumber grades 1 & 2.
2. Built-up lintels must be constructed of full length members. No splicing of members is permitted between supports.
3. Supported length means half the span of trusses, roof joists, or rafters supported by the lintel plus the length of the overhang beyond the lintel (see Figure 10).
4. If the supported length is between the sizes shown, use the column with the greater depth. For garages or storage sheds with a door width or supported length greater than shown on the tables, consult a Professional Engineer.
5. The spans shown in the table are the clear spans between the load bearing supports at each end of the lintel. To find the total length of lintel needed, add the bearing lengths of the support to the clear span.
6. The minimum bearing length of the support at each end of the lintel must be 89 mm where spans are greater than 3.6 m; Where spans are less than 3.6 m, the minimum bearing length of the support at each end of the lintel must be 76 mm.
7. Lintel sizes smaller than those shown on these tables may be used provided the lintel has been designed by a Professional Engineer and the lintel design and calculations are submitted and accepted.
8. The above noted lintels are not designed to carry masonry or floors above the overhead door. For these types of applications consult a Professional Engineer.
9. Glue Laminated Timber to conform to CAN/CSA-0122-M and CAN/CSA-0177-M and 20fE stress grade.


Lintel Size Selection For An Overhead Door Example

In order to select the correct size of lintel in cases where it is supporting the roof, three pieces of information are needed: the size of the garage, the width of the overhead door opening, and the size of the roof overhang. As an example, assume a 7.32m x 7.32m garage with a 2.74m overhead door opening and a 600mm overhang. Refer to Table 4.

Begin by selecting the row for a 2.74m overhead door opening. Next, knowing that the supported length will be half the distance of the roof span plus the overhang (see FIGURE 10), we divide the 7.32m roof span distance by 2 and add the 600mm roof overhang to get the total supported length of 4.27m.

Now looking along the table to column 4 where the supported length is 4.27m, we see that the proper size of lintel would be 3 - 38 x 235mm.

FIGURE 10 - Supported Length of Wood Lintel.

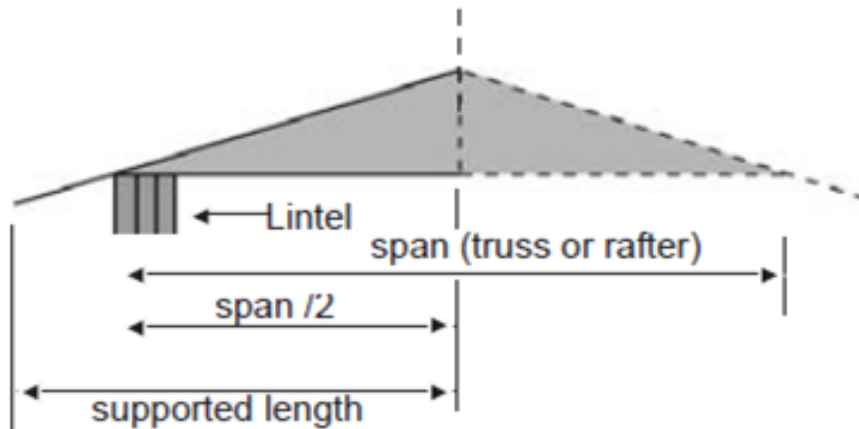

Rafters And Trusses

In wood framing, there are basically three methods for framing roofs. They are:

- 1) Framing the roof with pre-manufactured trusses
- 2) Framing the roof with individual pieces of lumber
- 3) Framing the roof with “home made” trusses

1) Framing the roof with pre-manufactured trusses

There are several truss manufacturers and suppliers listed in the Yellow Pages and online under both LUMBER-RETAIL and TRUSSES. These firms can provide detailed information regarding the proper installation of their products.

Note: When using trusses or rafters at 600mm spacing with panel-type roof sheathing of less than 12.7mm thickness, support must be provided to all edges of each roof sheathing panel including those that meet at the ridge. This can be accomplished with the use of ‘H’ clips as shown in FIGURE 11 and/or solid blocking.

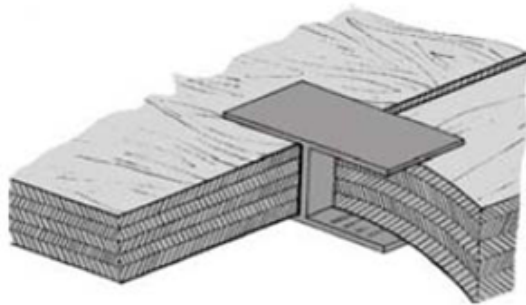


FIGURE 11 - ‘H’ Clip Detail

2) Framing the roof with individual pieces of lumber

This is commonly known as stick framing. Figure 12 shows a typical cross section of a gable roof and Table 5 indicates maximum rafter spans for various species and sizes of rafters. Note that Figure 12 makes use of collar ties as a means of reducing a full rafter span into two smaller spans. Collar ties can only be used in this fashion when the roof slope is 1 in 3 or greater.

If you are framing a roof containing hip or valley rafters, the hip and/or valley rafters must be not less than 50mm greater in depth than the common rafters and not less than 38mm in thickness.

FIGURE 12 - Roof Rafter and Collar Ties for Gable Roof.

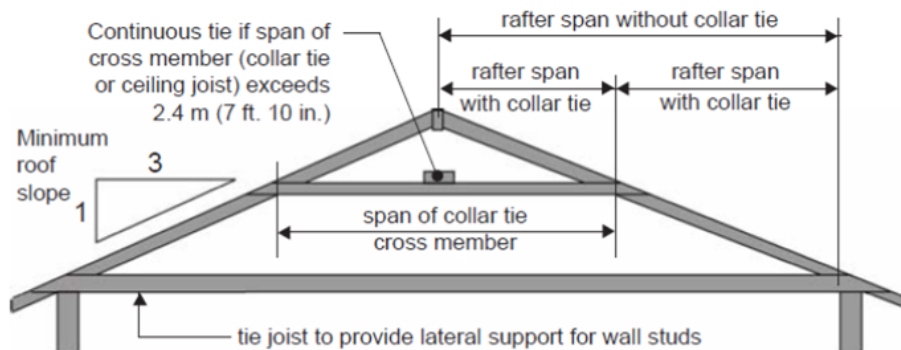


Table 5: Roof Rafter Spans — Rafter NOT SUPPORTING Ceiling

Commercial Designation	Grade	Member Size (in.)	Rafter Spacing			Member Size (mm)	Rafter Spacing		
			12 in	16 in	24 in		300 mm	400 mm	600 mm
			Ft- in	Ft- in	Ft- in		m	m	m
Spruce —	No. 1	2 x 4	8' 11"	8' 1"	7' 1"	38 x 89	2.72	2.47	2.16
Pine —	And	2 x 6	14' 0"	12' 9"	11' 1"	38 x 140	4.28	3.89	3.40
Fir —	No. 2	2 x 8	18' 5"	16' 9"	14' 5"	38 x 184	5.62	5.11	4.41
		2 x 10	23' 5"	21' 4"	17' 8"	38 x 235	7.18	6.52	5.39
		2 x 12	28' 8"	25' 1"	20' 6"	38 x 286	8.74	7.66	6.25

Table 5 Notes:

This table applies to roofs with a slope of 1 in 3 or greater. Roof slopes of less than 1 in 3 are subject to different loading conditions, e.g. adequate ridge support must be provided.

Roof Rafter Size Selection Example

In order to select the correct rafter size for a 6.72m x 6.72m detached garage or storage shed with a gable roof having a slope of 1 in 3 or greater, and with spruce rafters (without collar ties) spaced 600mm apart, we will proceed as follows.

First, we must know the horizontal distance from the wall to the peak of the roof. In this example the distance is 6.72m divided by 2 or 3.36m, and is called the rafter span.

Next, keeping in mind that 3.36m is the required rafter span distance, we look to Table 5 in the Spruce - Pine - Fir section for a 600mm rafter spacing. We are looking here for a span distance that equals or exceeds 3.36m. We find in the table a span that meets our requirements and it has a figure of 3.40m. We now look across to find the member size that is necessary to obtain this span. It is a 38 x 140mm rafter. This rafter size is the minimum size of rafter required for the span of 3.36m for this particular gable style roof.

If collar ties are permitted and are used, the required span would be less than 3.36m and a smaller member size could be looked up in the table.

3) Framing the roof with “home made” trusses

This is not a recommended design. The truss must be designed by a Professional Engineer registered in the Province of Ontario.

Note: The use of gang nailers (metal plates) in manufacturing “home made” trusses is not permitted unless extensive engineering involvement and testing is carried out and the supporting documentation is submitted and found acceptable. These types of fasteners are only intended for use under the design and quality control of a truss manufacturer.

Truss designs vary depending upon spans, roof slope, etc. Before manufacturing your own trusses, obtain an accepted truss design drawing showing the span, the size of the members, the size and thickness of the plywood gussets, and the nailing patterns. Do not copy truss designs used on other buildings. These designs may be inadequate for your application.

Are there any other Building Code requirements?

Yes, there are various other requirements concerning framing, sheathing materials, sheathing paper, flashing, siding, shingling, and stucco application, etc. Most of these aspects of construction are dealt with in the previously mentioned book available from Canada Mortgage and Housing.

Further information

Planning & Building requirements may vary, depending on property lots. We strongly encourage applicants to discuss their specific project with Building Services within the City of Sarnia prior to commencement.

building@sarnia.ca

519.332.0330



**City of Sarnia,
Building & By-Law Services**

255 North Christina Street

Sarnia, ON N7T 1N2

Phone: 519-332-0330

Fax: 519-332-0776

E-mail: building@sarnia.ca

www.sarnia.ca



SARNIA
O N T A R I O